


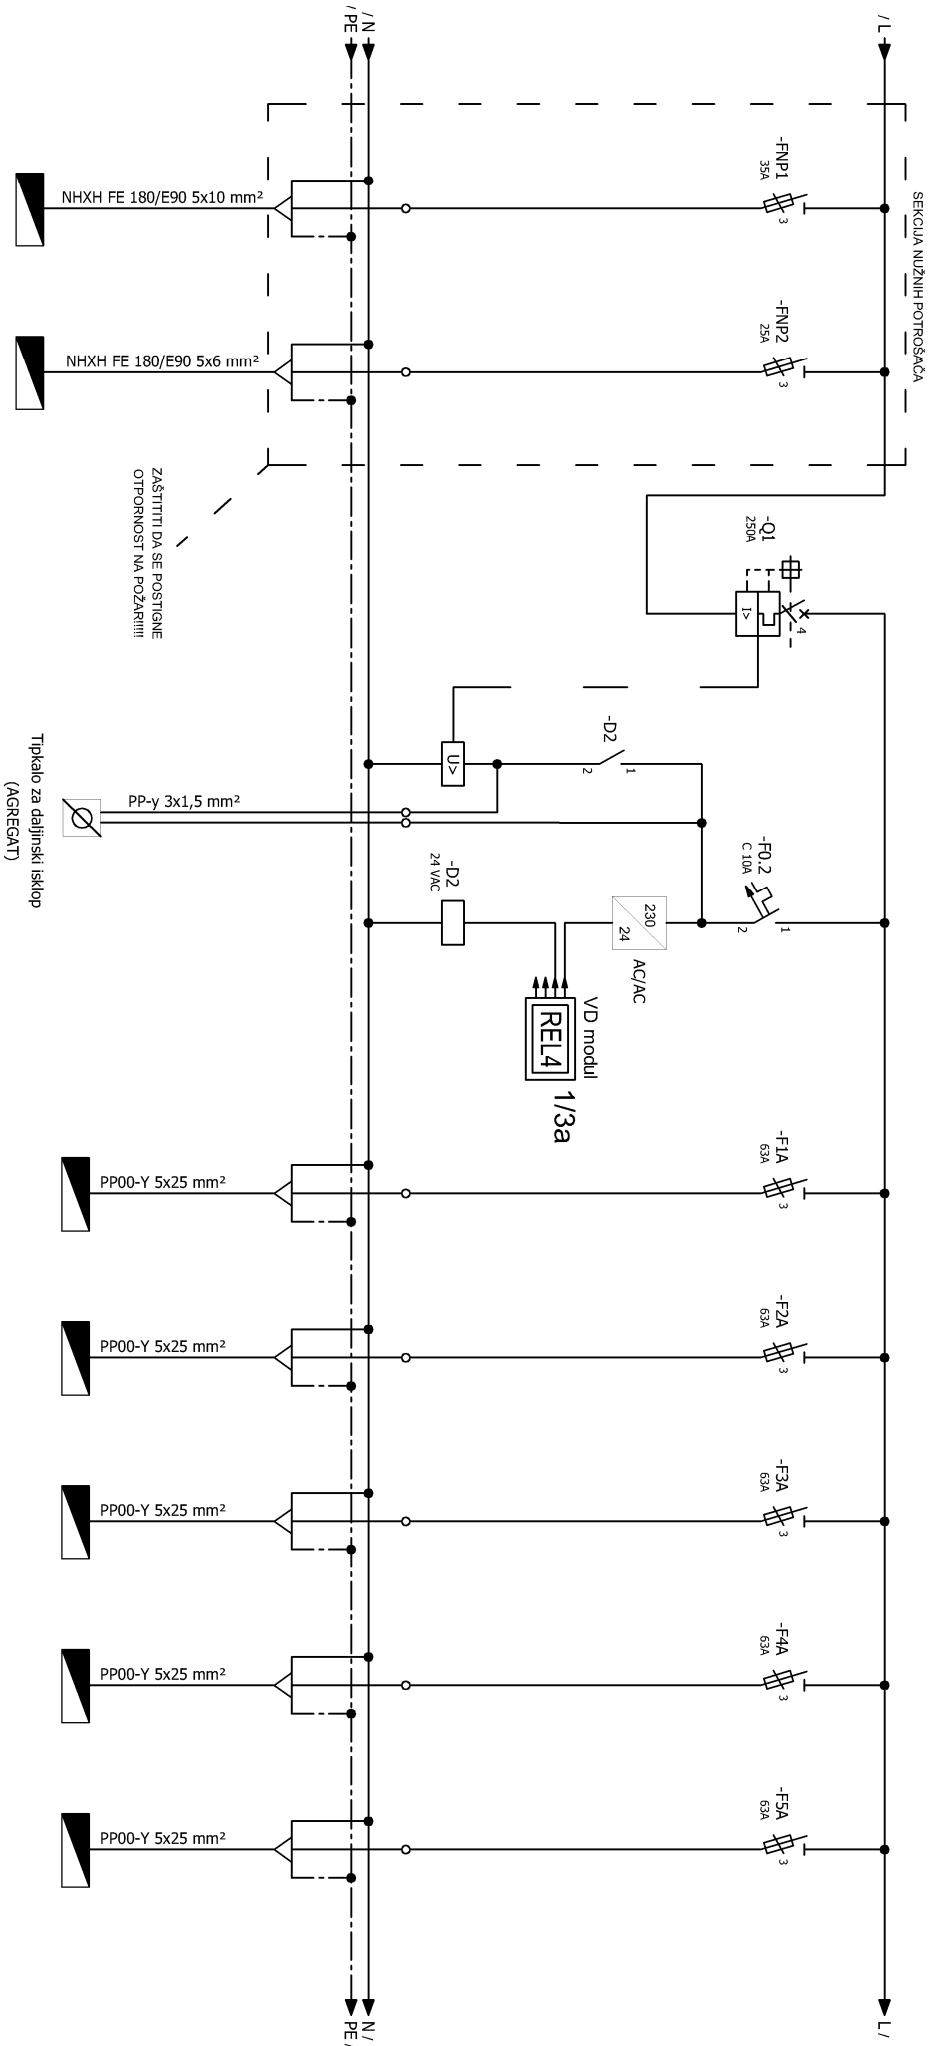

STRUJNI KRUG:	1NP	2NP						
INSTAL. SNAGA:	5,0 kW	3,0 kW						
POTROŠAČ:	RO/D1	RO/SPR						
				1A	2A	3A	4A	5A
				15,0 kW	15,0 kW	15,0 kW	15,0 kW	15,0 kW
				RO/50	RO/20	RO/51	RO/11	RO/52

INVESTITOR : MIRJAM i.d.o.o.

GRADEVINA : HOTEL **** "MIRJAM"

LOKACIJA : k.č.z. 831/10, K.O. VELIKO BRDO

PROJEKT : ELEKTROTEHNIČKE INSTALACIJE

PROJEKTANT:
MLADEN TOMIĆ, dipl.ing.el.

FAZA:
IZVEDBENI PROJEKT

MJERILLO:
-

ZOP:
AH-LL-01/14



d.o.o. za projektiranje, nadzor i izvođenje
električnih instalacija, Katalina 16, Makarska
MB: 060014265, OIB: 41489075623
Tel: 021613-425, e-mail: in-1000@si-t.com.hr

SADRŽAJ:

JEDNOPOLNA SCHEMA
RAZDJELENIK GRO

BROJ PROJEKTA:
TD-E-17/50

DATUM:
07.2017.g.

LIST BROJ:
4/7

NACRT BROJ:
4.24

POTPIS I PEČAT:



MLADEN TOMIĆ
mag.ing.el.
OVLAŠTENI INŽENJER
ELEKTROTEHNIKE
E2425